

	
	YW-20190404-001
	2019-04-04
IM267	1
	15

IM267

IM267

: 135 7383 0623

QQ:1774880258

RV2025

2755

<http://www.jnrovin.com>





			
		YW-20190404-001	
		2019-04-04	
IM267		4	15
	20.4-28.8V DC		
	2A		
	500V		
5V DC	1500mA		
x x	71 x 80 x 62		

1.4

IP

1.5


IM267IM267GSDMLIM 267GSDML“ PROFINET



IM267GSDML”IM267

PROFINETS7-200I/OIM267LAN

PROFINET

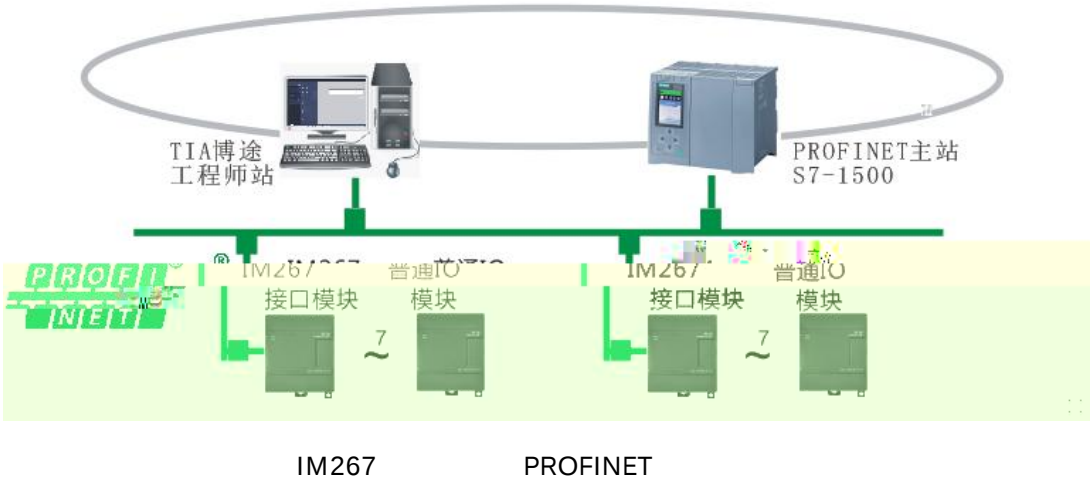

	
	YW-20190404-001
IM267	2019-04-04
	5 15

1.6 LED

IM267 LED

	0/	_____	
	,	,	

2 TIA V15 IM267

IM267 S7-1215C PROFINET CPU

1200 IM267 I/O TIA Portal V15

2.1

IM267

S7-1200CPU

200 222-1PL22 + 222-1HH22 + 232-0HD22 + 231-7PC22

PROFINET

2.2


2.2.1

1 TIA Portal 1200






		
	YW-20190404-001	
IM267	2019-04-04	
	7	15

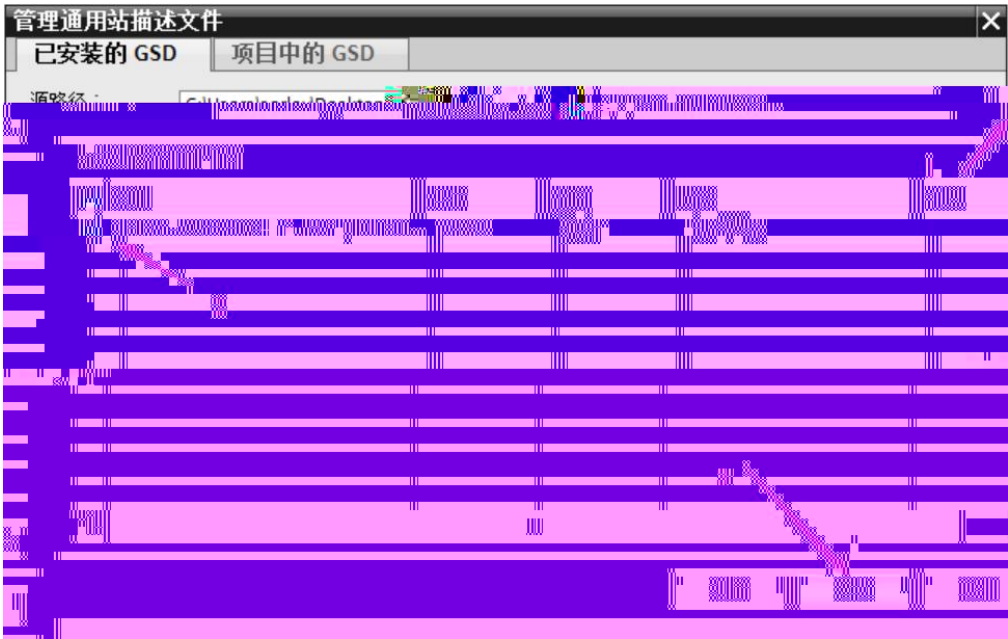

		
	YW-20190404-001	
IM267	2019-04-04	
	8	15

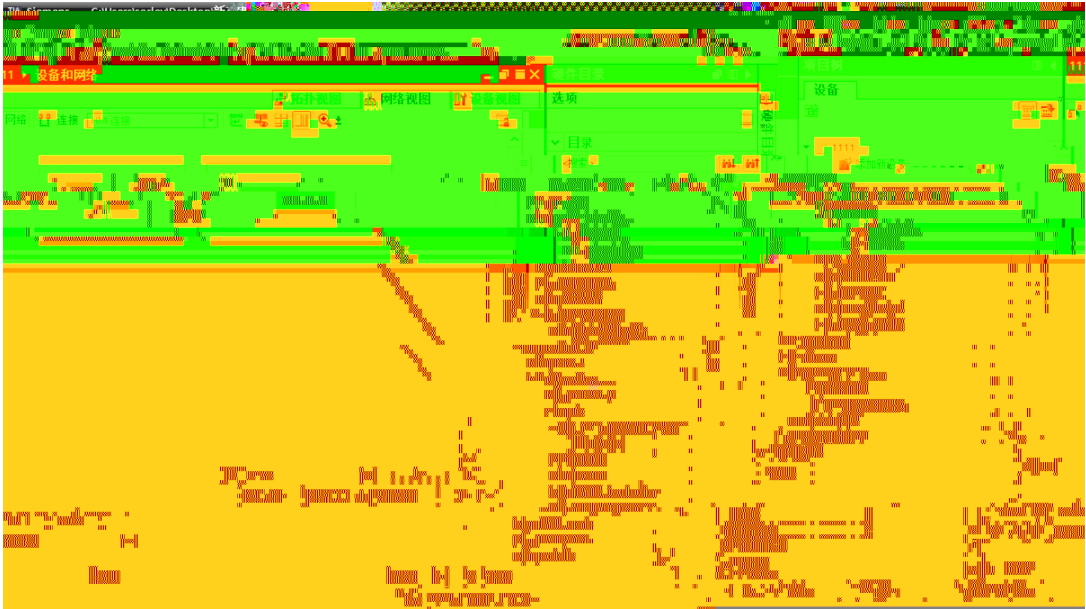


4

PLC IM267


PN/IE_1

IP

		
	YW-20190404-001	
	2019-04-04	
IM267	9	15

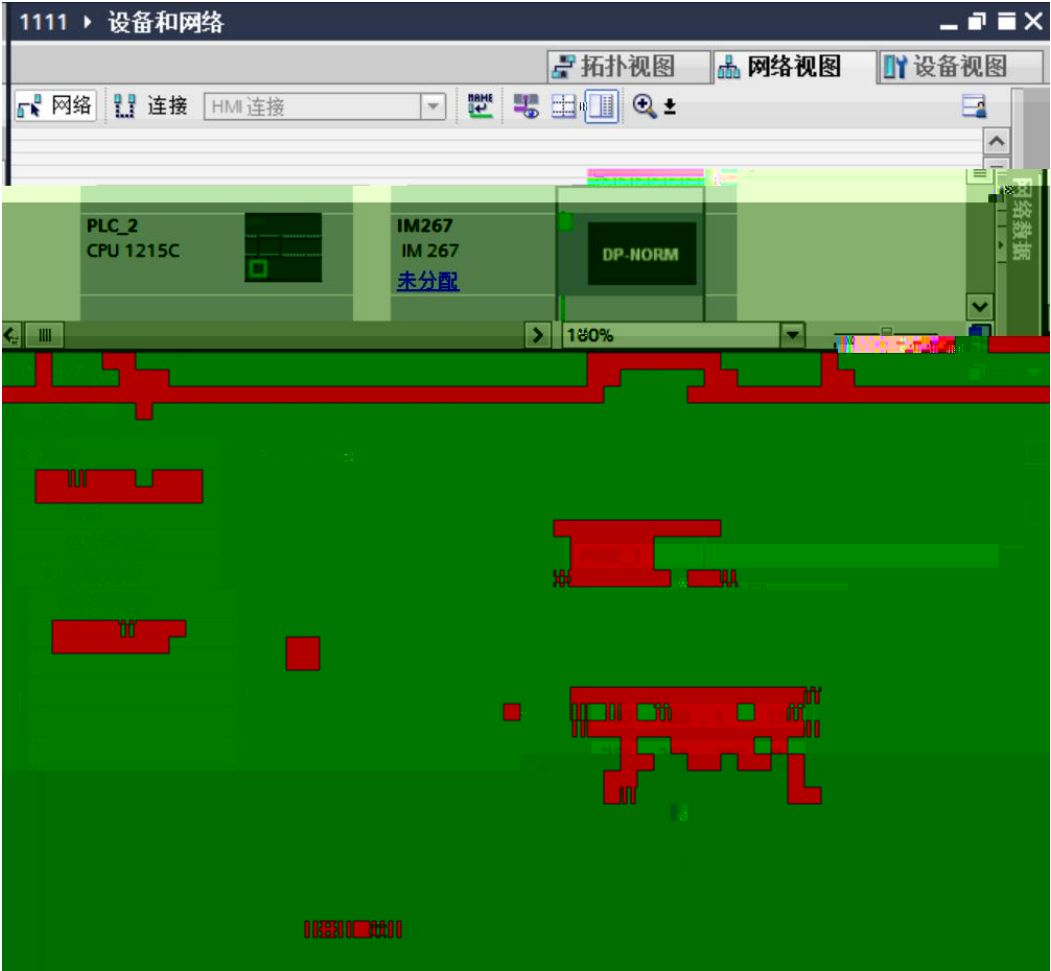

CPU ,

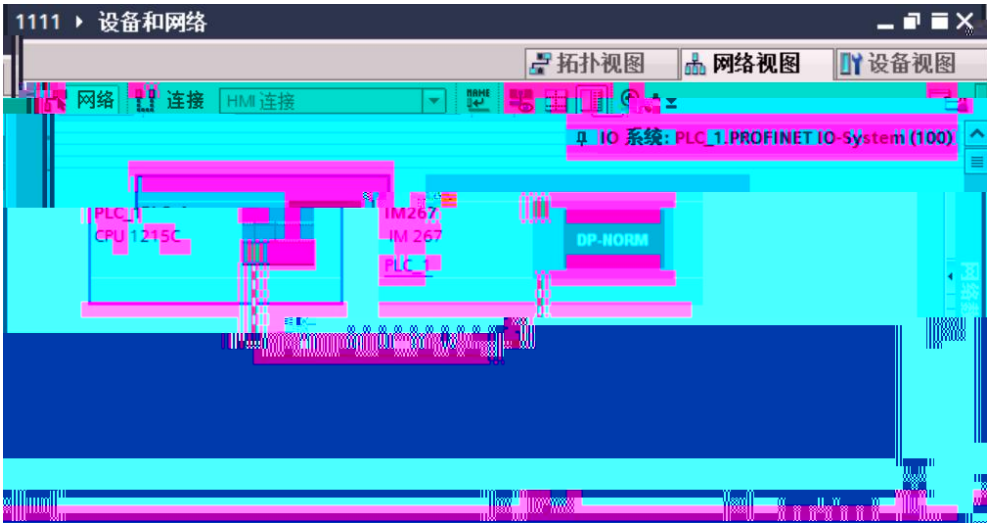

		
	YW-20190404-001	
IM267	2019-04-04	
	10	15

5



6 IM267 IP 4 267 IP

IP IM267- -

IM267






		
	YW-20190404-001	
	2019-04-04	
IM267	12	15

8

CPU

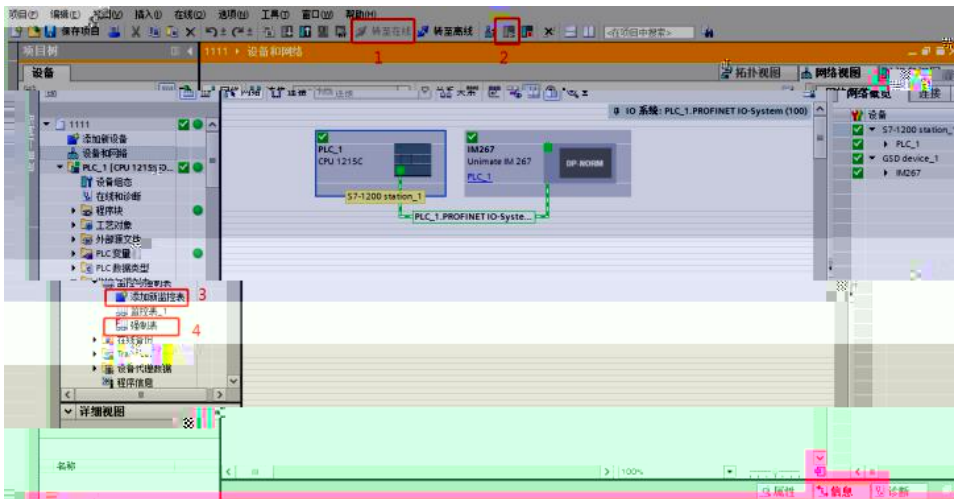

9

QW10,QW14 16000

5V,10mA

IW42

10


200PLC



		
		20190404-001
IM267		19-04-04

B

		
	YW-20190404-001	
	2019-04-04	
IM267	15	15

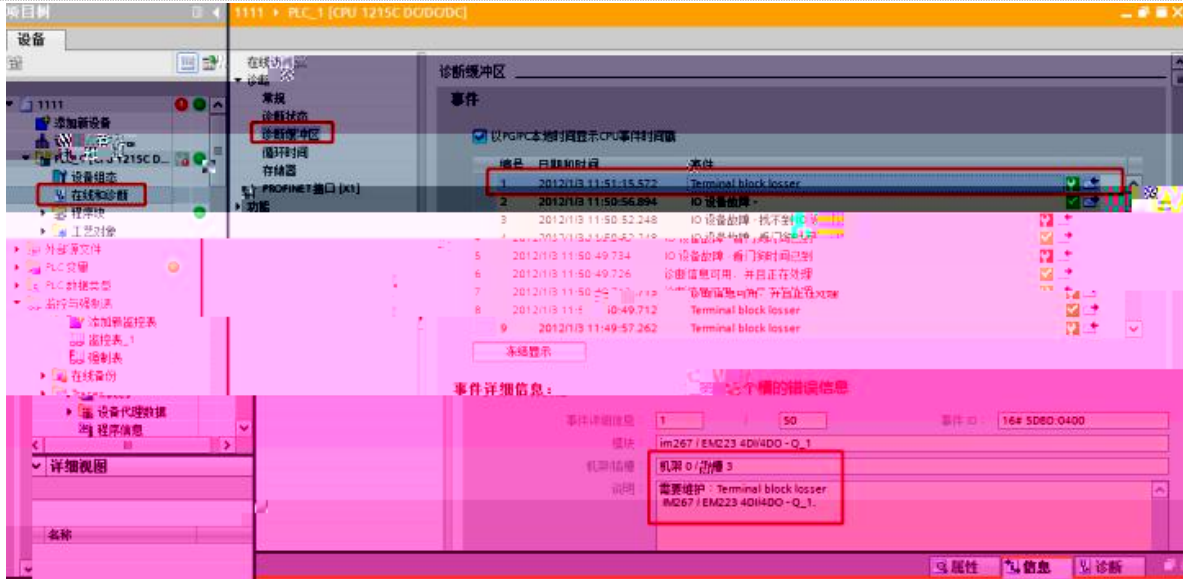

Terminal block loss——
 Blown fuse Err——
 No user power Err——
 Out of-range Err——
 Bus Fault or parity err——
 Config Mask——

4

IM267

